


POWERWISE SYSTEMS HARDWARE DIAGRAM

SiteSage Energy Monitor, Gateway, sPod, Gas Meter LAYOUT 1.0



PowerWise Systems
124 Main Street
Bucksport, Maine 04416

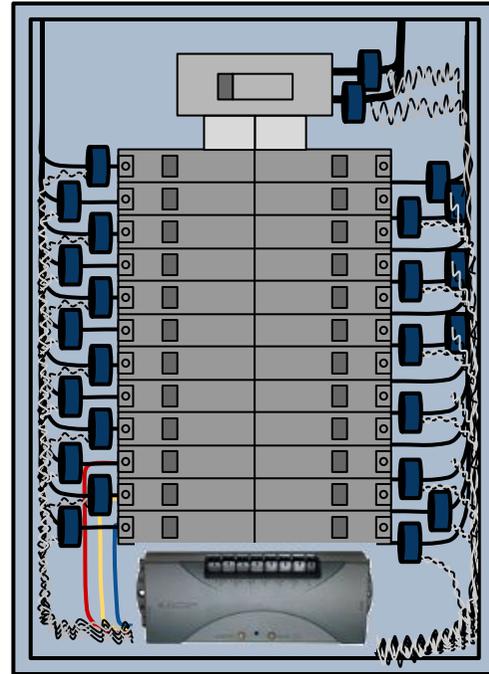

Electrical Panel

NOTES:

- I. Gateway must be within 30 feet of the SiteSage Energy Monitor and the sPod.
- II. SiteSage Energy Monitor is powered by a 15A breaker inside the panel.
- III. Cellular modem can be installed in Leviton Enclosure to provide network access.

LEGEND:



SiteSage Energy Monitor



SiteSage Gateway




SiteSage xPod - Up to 3 can be daisy chained to energy monitor to add more channels. Each xPod adds 10 channels. xPod not pictured in panel.



sPod - 30 foot communication range with SiteSage gateway



CAT5 or better

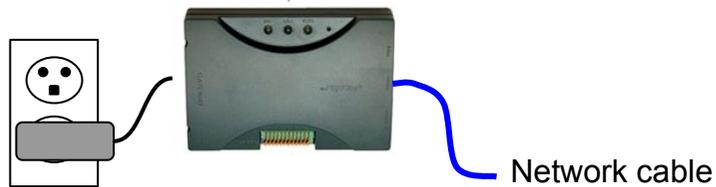

Gateway includes 3.3 VDC power supply. Device can also be powered over ethernet.

